

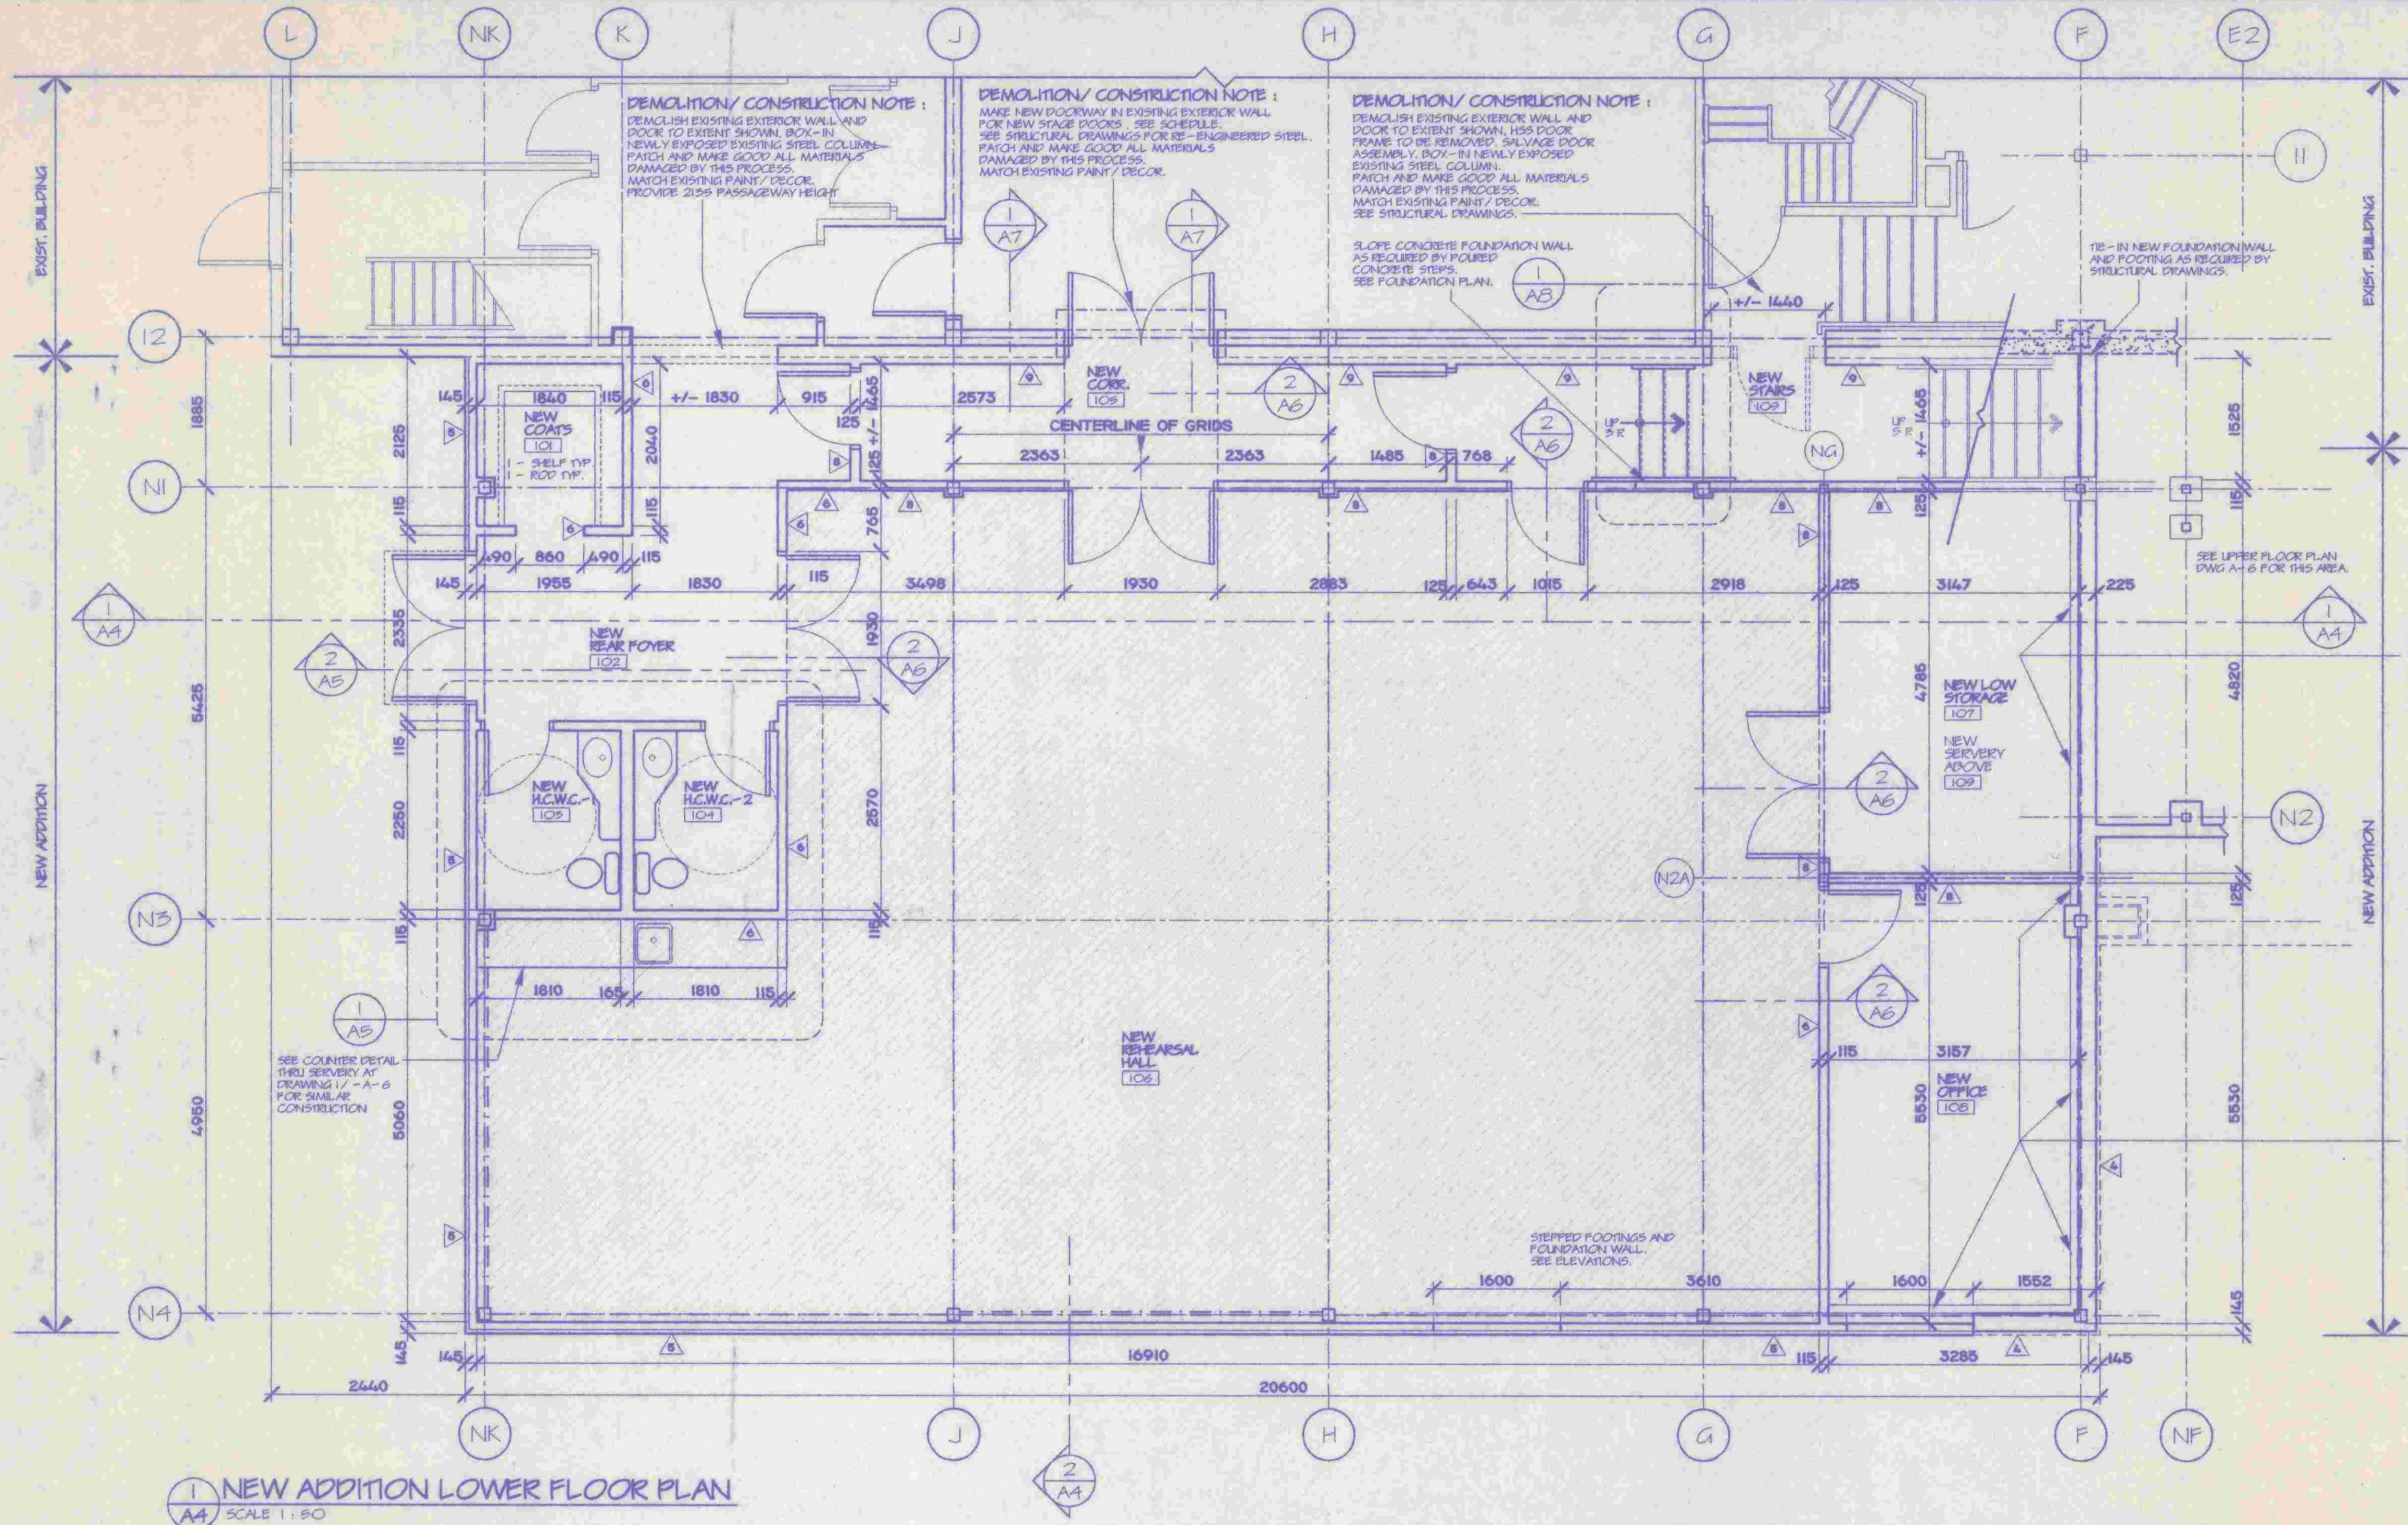
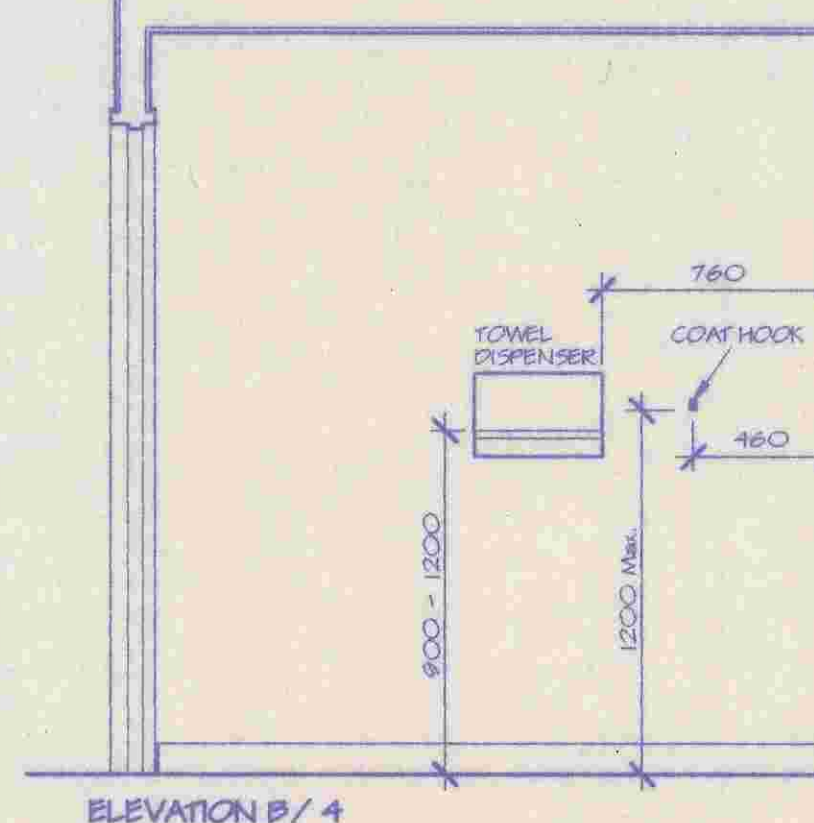
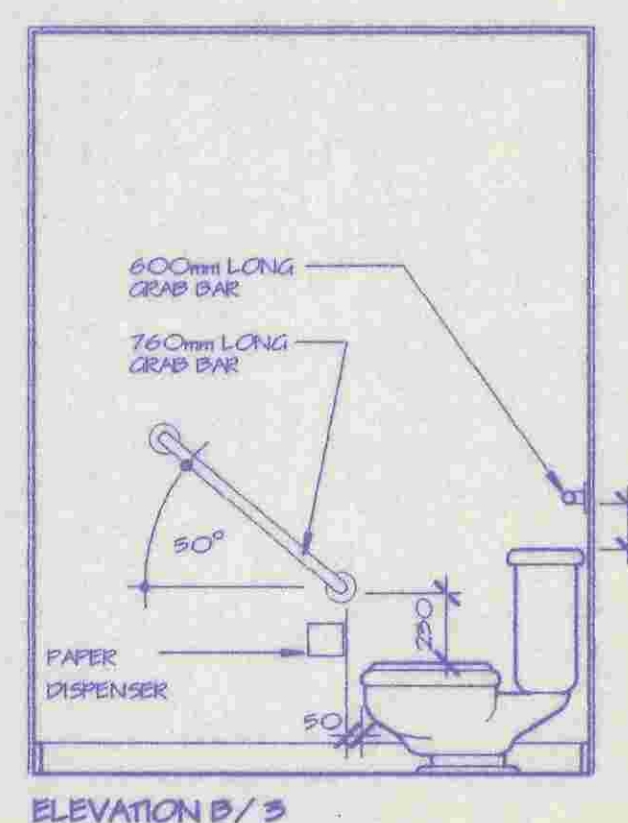
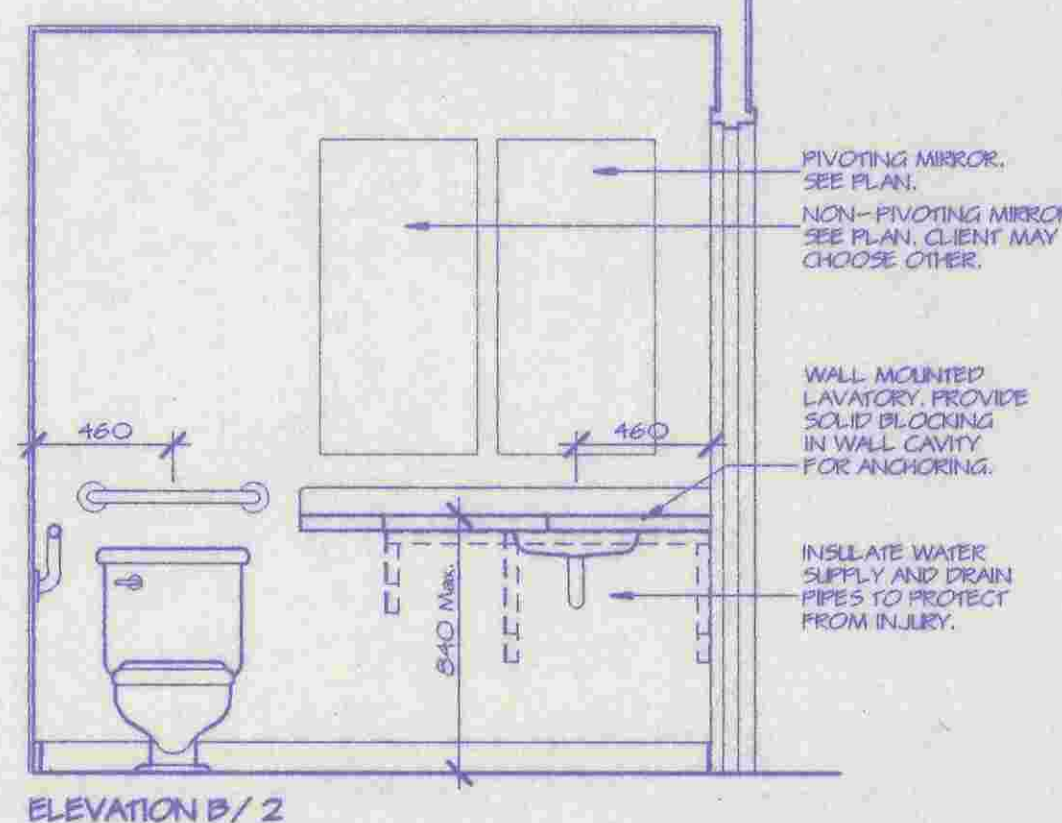


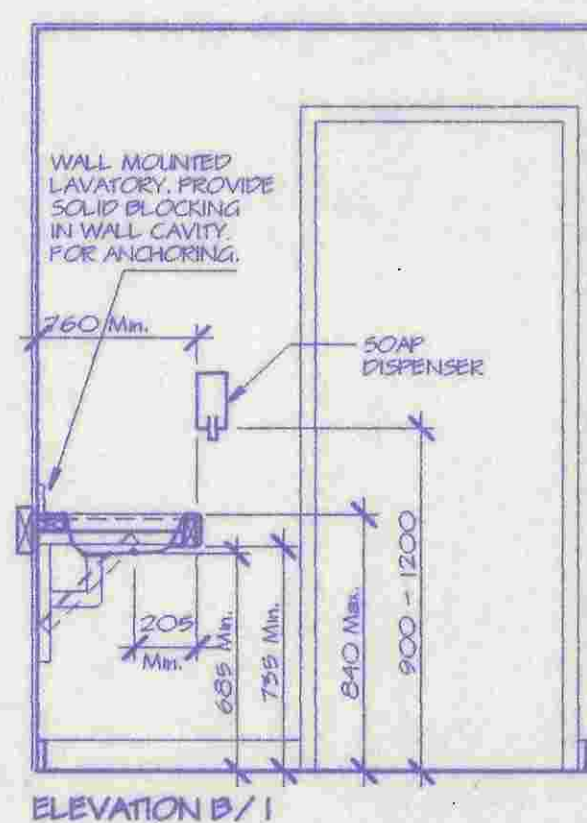

No.	ISSUE/REVISIONS	DATE
1	ISSUED FOR PERMIT	MAR 9'01

CONSTRUCTION LEGEND:

- NEW FOOTING CONSTRUCTION:**
 REINFORCED POURED CONCRETE FOOTINGS ON UNDISTURBED SOILS OR BEDROCK. REFER TO STRUCT. DWGS. FOR SIZES & STRENGTHS OF CONCRETE. CONTINUOUS 150mm DIA. WEPPING TIE-INS INTO EXISTING @OUTER PERIMETER W/ 150mm MIN. CLEAN GRANULAR COVER.
 - TYPICAL FOUNDATION WALL CONSTRUCTION:**
 150mm MIN. PARAPET AT ALL EXPOSED CONCRETE FOUNDATION WALLS TO 150mm BELOW GRADE. POURED CONCRETE FOUNDATION WALLS. SEE STRUCT. DWGS. FOR SIZES AND STRENGTHS. 2" CONTINUOUS RIGID SM INSULATION TO FOOTING.
 - TYPICAL SLAB ON GRADE CONSTRUCTION:**
 MACHINE TROMMELLED SMOOTH REINFORCED POURED CONCRETE SLAB. SEE STRUCT. DWGS. FOR SIZES AND STRENGTHS. 6 MIL POLY VAPOUR BARRIER ON CLEAN, COMPACTED GRANULAR BASE ON UNDISTURBED SOILS OR BEDROCK.
 - TYPICAL NEW FLOATING FLOOR CONSTRUCTION:**
 6mm TEMPERED MASONITE ON 2 LAYERS OF 16mm PLYWOOD. RESILIENT CUSHION PADS @900mm CENTERS EACH WAY. 6 MIL POLY VAPOUR BARRIER FLOOR SYSTEM TO BE APPLIED UPON SLAB ON GRADE. SEE NOTE-3. PROVIDE 5mm (1/8") SHALLOW GAP IN MASONITE FLOOR TRIM FIELD TYPICAL & 15mm (1/2") AT FLOOR EDGES.
 - TYPICAL NEW EXTERIOR WALL CONSTRUCTION:**
 100mm PRE-FINISHED METAL SIDING TO MATCH EXISTING. 25mm RIGID SM INSUL N WITHIN 38mm (3/4") JOINTS. 15mm GYPSUM BOARD ON 90mm STEEL STUDS @400mm OC. C/W 90mm BATT INSULATION. 6 MIL POLY VAPOUR BARRIER. 15mm GYPSUM BOARD. SEE FINISH SCHEDULE. SEE STRUCT. DWGS. FOR SUPPORT STEEL INTEGRATION.
 - TYPICAL INTERIOR WALL CONSTRUCTION:**
 15mm GYPSUM BOARD EACH SIDE OF 92mm METAL STUDS @600mm OC. (OR AS NOTED ON PLANS) TO UNDERSIDE OF CEILING (OR TO UNDERSIDE OF STEEL DECK AS NOTED ON PLANS). C/W 92mm SOUND ATTENUATION FIRE BLANKETS WITHIN CAVITY. SEE FINISH SCHEDULE FOR INTERIOR FINISH.
 - TYP. INT. WALL W/ SOUND ATT.N CONSTRUCTION:**
 15mm GYPSUM BOARD EACH SIDE OF 92mm METAL STUDS @600mm OC. (OR AS NOTED ON PLANS) TO UNDERSIDE OF CEILING (OR TO UNDERSIDE OF STEEL DECK AS NOTED ON PLANS). C/W 92mm SOUND ATTENUATION FIRE BLANKETS WITHIN CAVITY. SEE FINISH SCHEDULE FOR INTERIOR FINISH.
 - TYP. 1-HOUR FIRE-RATED WALL CONSTRUCTION:**
 BASED ON ULC DESIGN No. W407 - 50C B1 16mm SHEETROCK FIRECODE "C" CORE - OR 16mm SHEETROCK W/ FIRECODE "C" PANELS EACH SIDE OF 92mm 25 GAUGE STUDS @610mm OC. C/W 76mm CREASED THERMAPIPER SOUND ATTENUATION FIRE BLANKETS (625mm (25") WIDE) WITHIN CAVITY. PERIMETER CALLED. SEE FINISH SCHEDULE FOR INTERIOR FINISH.
 - NEW 1-HOUR FIRE SEPARATION CONSTRUCTION:**
 TO BE APPLIED OVER EXISTING CONSTRUCTION AT ALL (12) EXISTING EXTERIOR SIDING REMOVED. SEE PLAN/ SECTIONS. 1 LAYER 15.9mm TYPE-X GYPSUM BOARD EACH SIDE OF 92mm STEEL STUDS AGAINST EXISTING 2-GIRT SYSTEM. CALL ALL JOINTS (SMOKE-TIGHT) AS REQUIRED. PROVIDE FIRE STOPPING AS REQUIRED.
 - TYPICAL NEW ROOF CONSTRUCTION:**
 ROOFING STONE BALLAST. 4-PLY BUILT-UP ROOF MEMBRANE (UP AND OVER PARAPET). 100mm TAPERED RIGID INSULATION TO DRAIN VAPOUR BARRIER. 50 RIGID INSULATION. 25mm STEEL ROOF DECK ON JOIST SIDES. SEE STRUCTURAL DRAWINGS FOR SUPPORT STEEL.
 - TYPICAL NEW SERVARY FLOOR CONSTRUCTION: (1 HR FIRE)**
 65mm POURED CONCRETE ON 25mm STRUCTURAL STEEL DECK ON 200mm C-CHANNELS @ 400 O/C. C/W 90mm BATT INSULATION. 15mm GYPSUM BOARD (TYPE-X). SEE STRUCTURAL DRAWINGS FOR SUPPORT STEEL.
- DRAWING / LEGEND NOTES:**
 - REFER TO DRAWING A-2 FOR:
 - OVERALL DIMENSIONS
 - WINDOW SCHEDULE REFERENCE BUBBLES
 - DOOR SCHEDULE REFERENCE BUBBLES

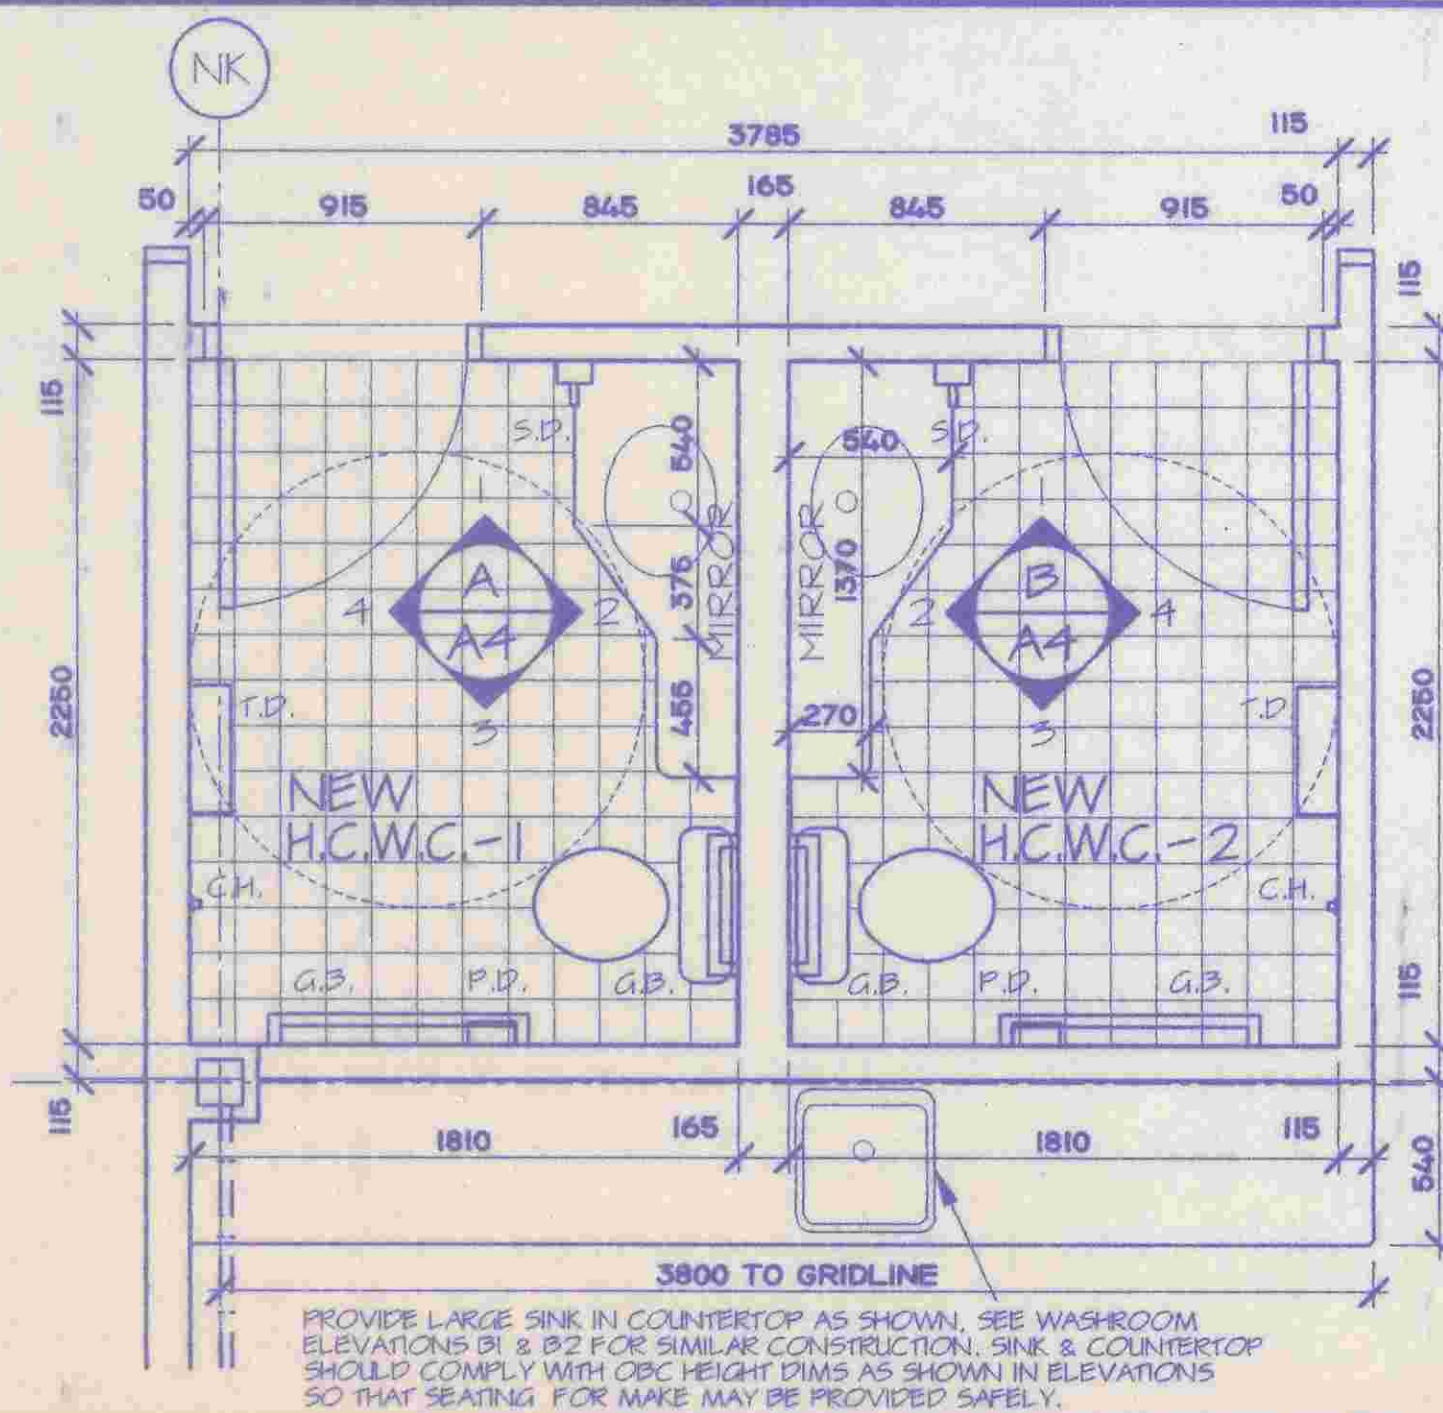

CITY OF KANATA
 REVIEWED
 FOR PURPOSE OF
 ISSUING PERMIT
 MAY 02 2001

BUILDING SERVICES DEPT.
 PROJECT NO. 2054
 ASK-1 AND ASK-2, ASK-3



GEORGE NICHOLS
 Architect Inc.
 260 HEARST WAY, SUITE 508, KANATA, ONTARIO, K2L 3H1.
 PHONE: (613) 591-0711
 FAX: (613) 591-0970
 E-MAIL: georgenichols@aibn.com

Project	ADDITION TO THE RON MASLIN PLAYHOUSE	Date	SEPT. 2000
Location	KANATA, ONTARIO	Scale	AS SHOWN
Drawn by	M.W. T.S.	Drawn by	M.W. T.S.
Project No.	2054	Project No.	2054
Drawn by	A-4	Drawn by	A-4
OF	SHEETS	OF	SHEETS

SITE COPY